

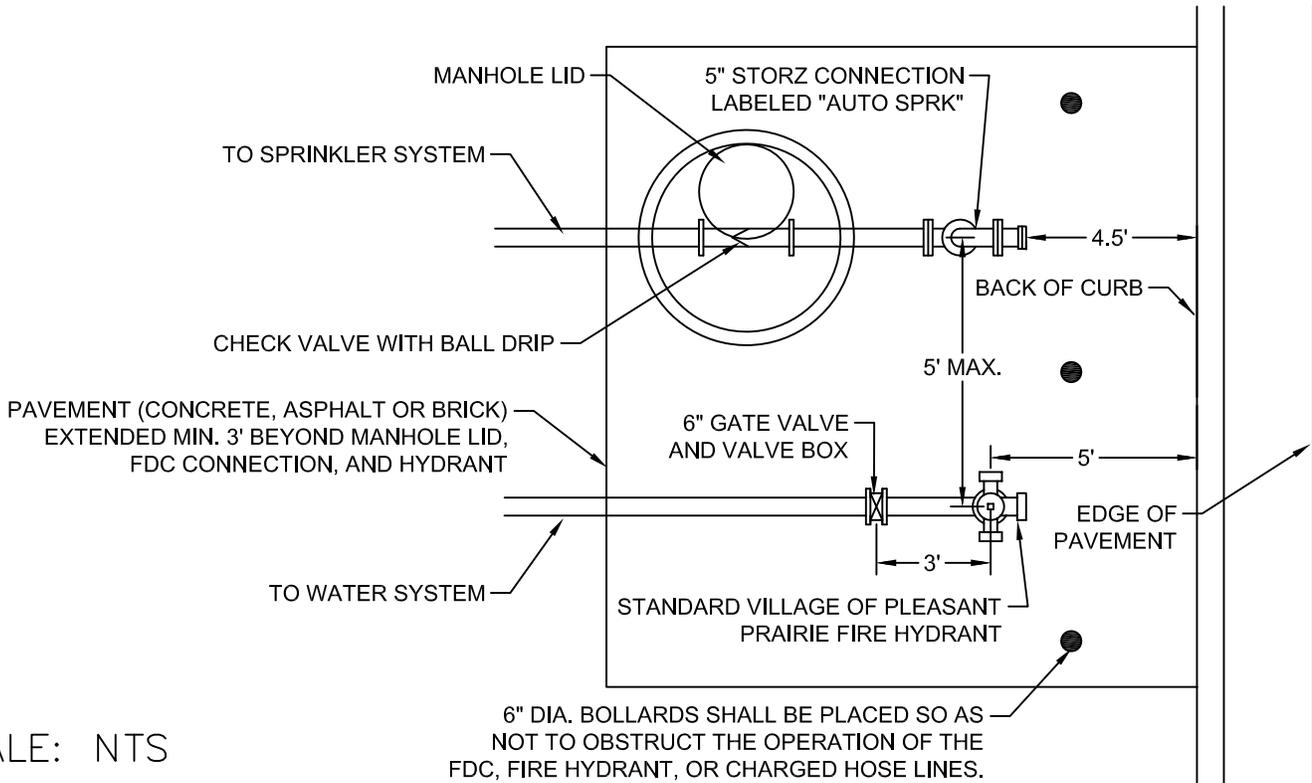


NOTE:

- SYSTEM SIZING SHALL BE COMPLETED BY A FIRE SUPPRESSION ENGINEER AND APPROVED OF BY THE VILLAGE OF PLEASANT PRAIRIE FIRE DEPARTMENT.
- SYSTEM INSTALLATION MUST BE CONSTRUCTED UNDER THE ONSITE SUPERVISION OF A LICENSED SPRINKLER FITTER.

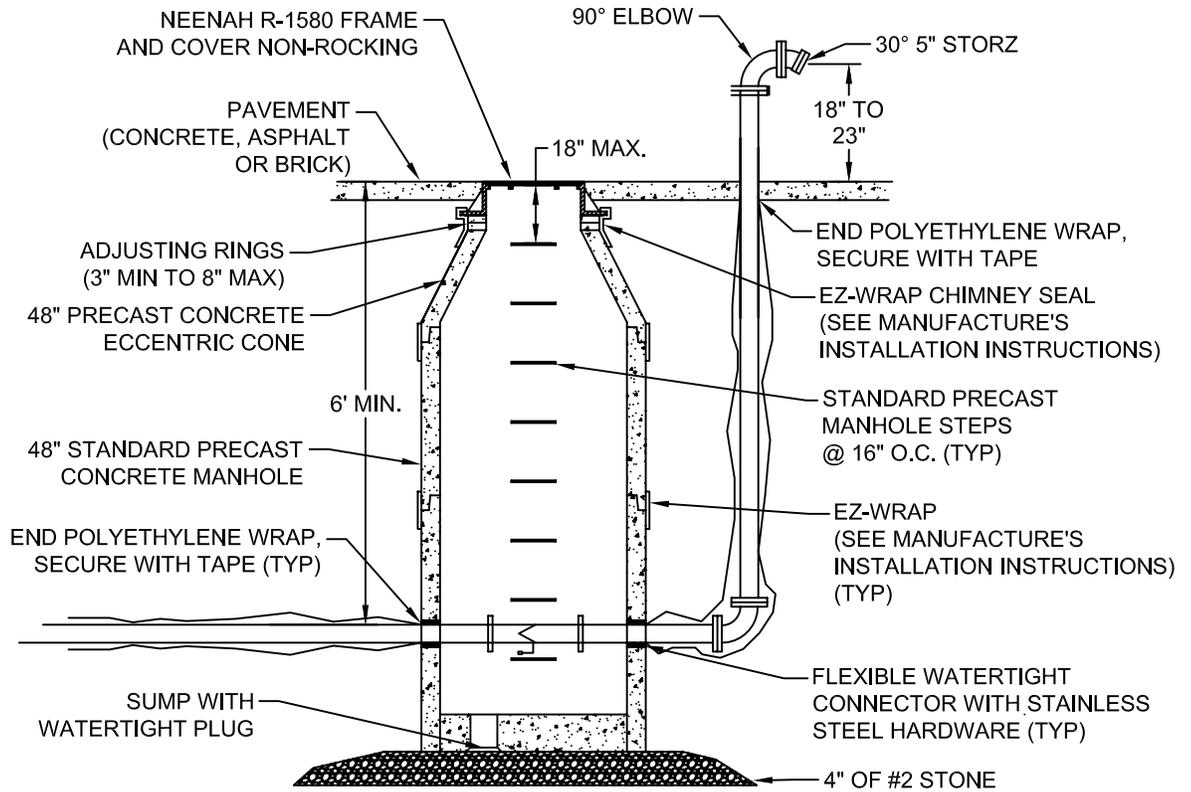

SCALE: NTS



PUMPER PAD FDC DETAIL

DETAIL: FD - 1

CREATED: 4-16-13

REVISED: 3-2-16

APPROVED BY: D. McELMURY

