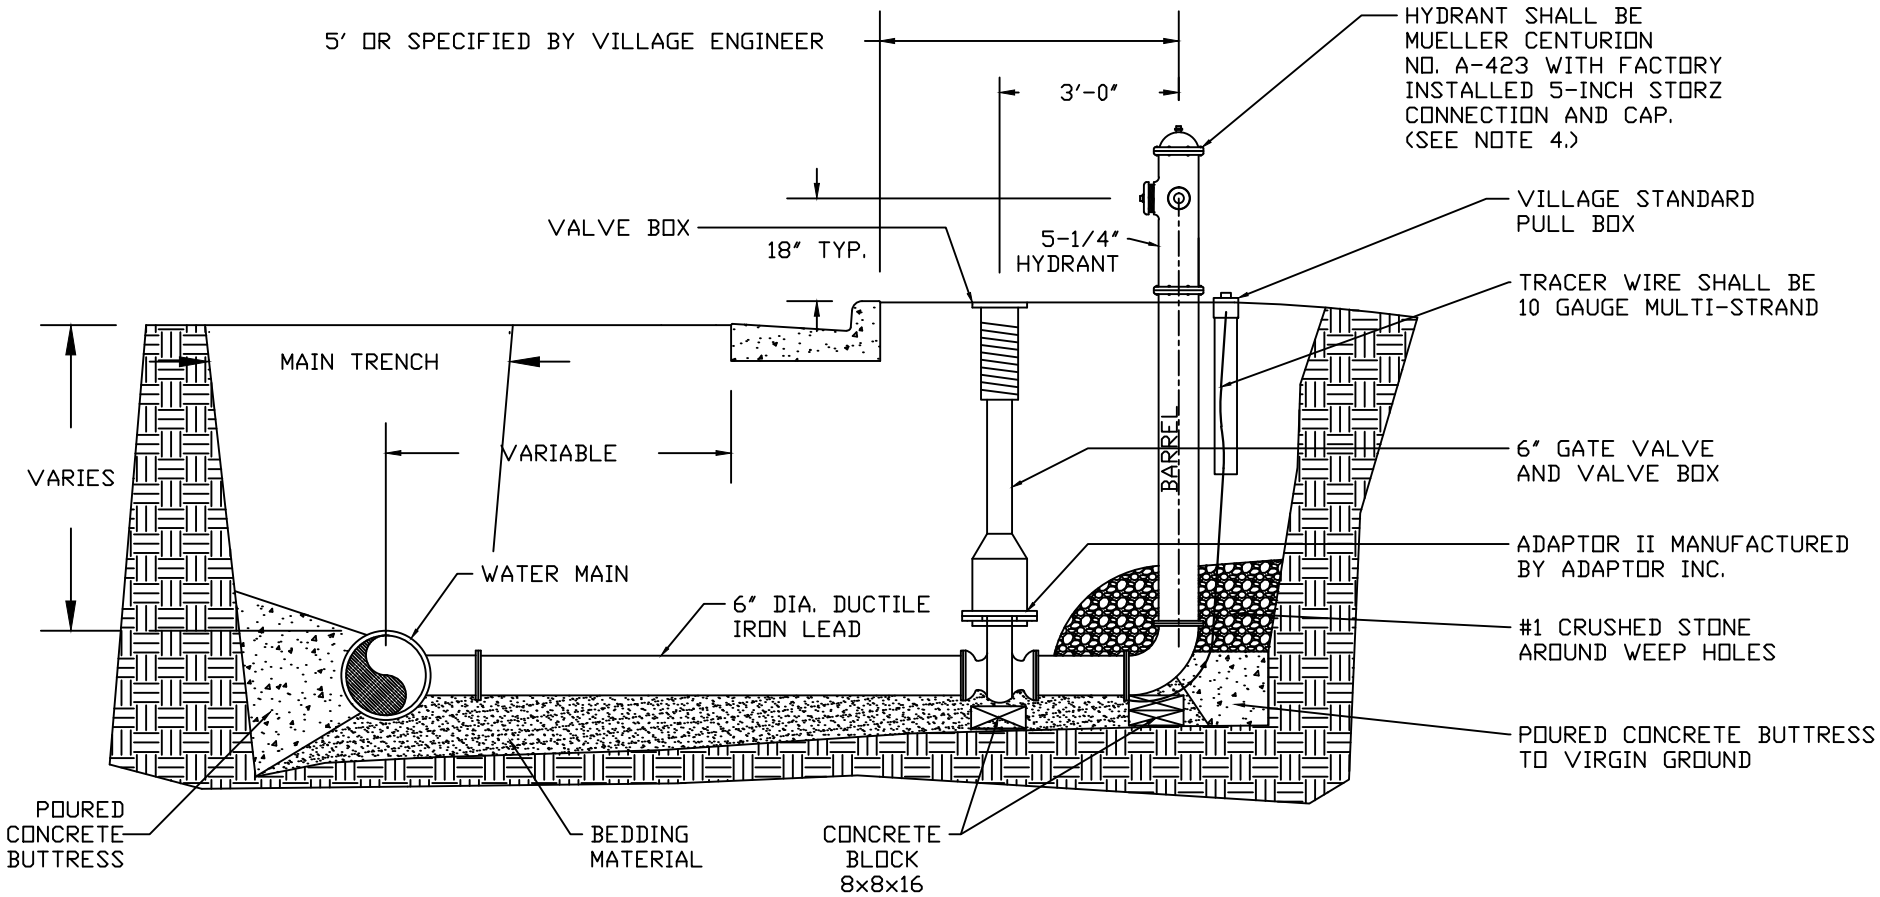

NOTES:

1. MECHANICAL JOINTS FROM TEE TO VALVE AND FROM VALVE TO HYDRANT SHALL BE RESTRAINED WITH MEGALUGS AND STAINLESS STEEL BOLTS.
2. ALL BOLTS SHALL BE STAINLESS STEEL BOLTS.
3. REFER TO VILLAGE STANDARD SPECIFICATIONS FOR WATER MAIN CONSTRUCTION
4. HYDRANT SPECIFICATIONS - 2 EACH 2-1/2 INCH NST NOZZLE, 1 FACTORY INSTALLED 5-INCH STORZ CONNECTION AND CAP MANUFACTURED BY MUELLER.
5. PAINT SPECIFICATION - PLEASE REFER TO VS-0400 OF THE VILLAGE CONSTRUCTION SPECIFICATIONS.

SCALE: NTS

VILLAGE OF PLEASANT PRAIRIE

Standard Hydrant Assembly

DETAIL: W - 1

CREATED: 11-26-12

REVISED: 1-26-15

APPROVED BY: MATT FINEOUR

Wisconsin Award for Municipal Excellence
Pleasant Prairie
Golden Cluster